

LIST OF FIGURES

- Figure 2.1 Soil Flushing System, Building 51/64 Groundwater Solvent Plume Source Area.
- Figure 2.2 Soil Flushing System, Building 71B Lobe of the Building 71 Groundwater Solvent Plume Source Area.
- Figure 2.3 Soil Flushing and Groundwater Migration Control Systems, Old Town Groundwater Solvent Plume.
- Figure 4.1 Berkeley Lab Groundwater CVOC Plumes.
- Figure 4.2 Extent of Land Not Suitable for Residential Use at Non-Radiological Units.
- Figure 4.3 Locations of Areas Where Institutional Land Use Restrictions are Imposed due to Groundwater Contamination.
- Figure 4.4 Locations of Areas of Underlain by Tritium-Contaminated Groundwater Not Released for Reuse by General Public.

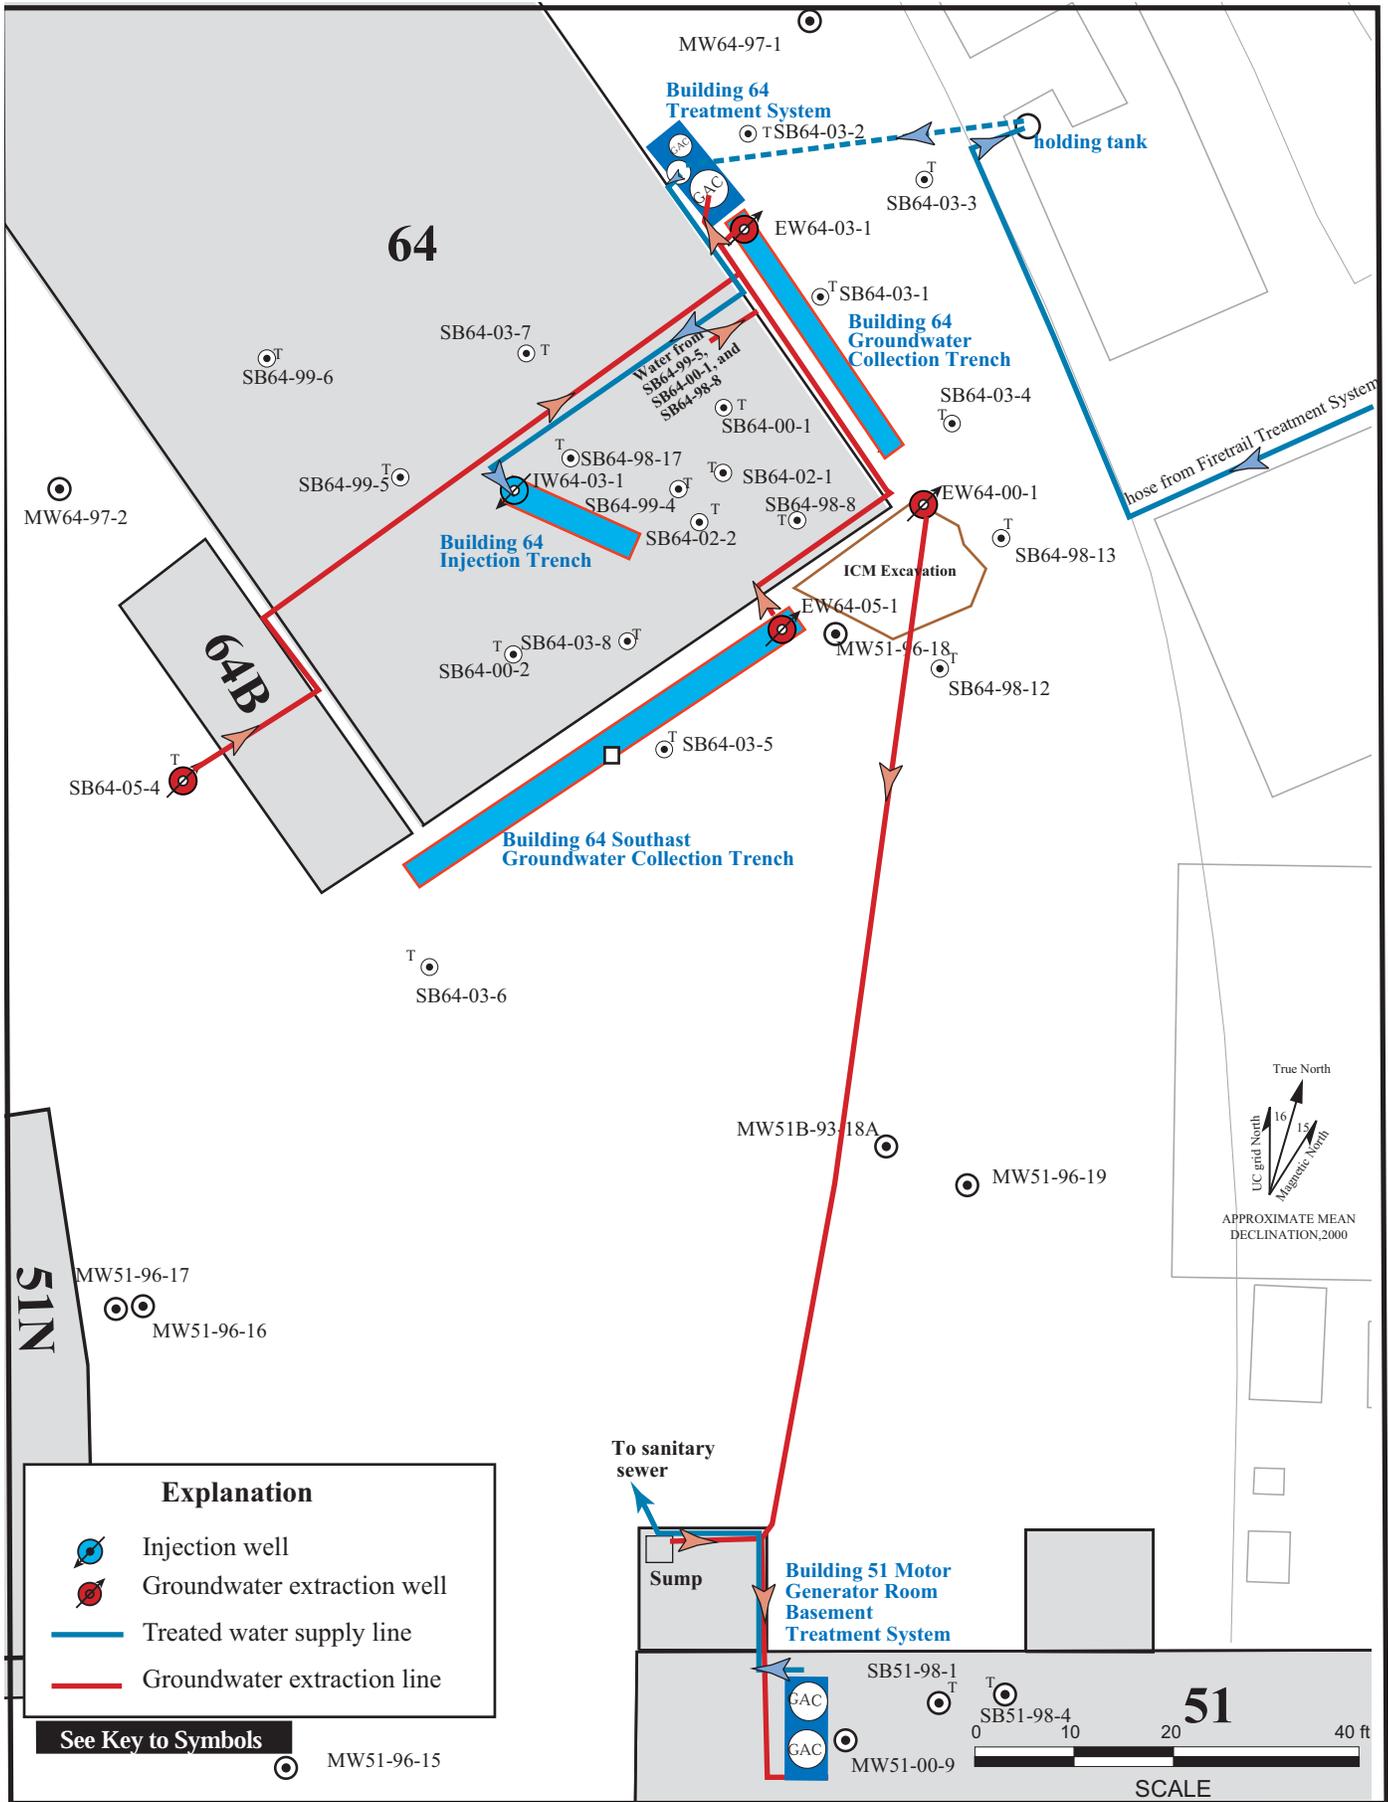


Figure 2.1. Soil Flushing System, Building 51/64 Groundwater Solvent Plume Source Area.


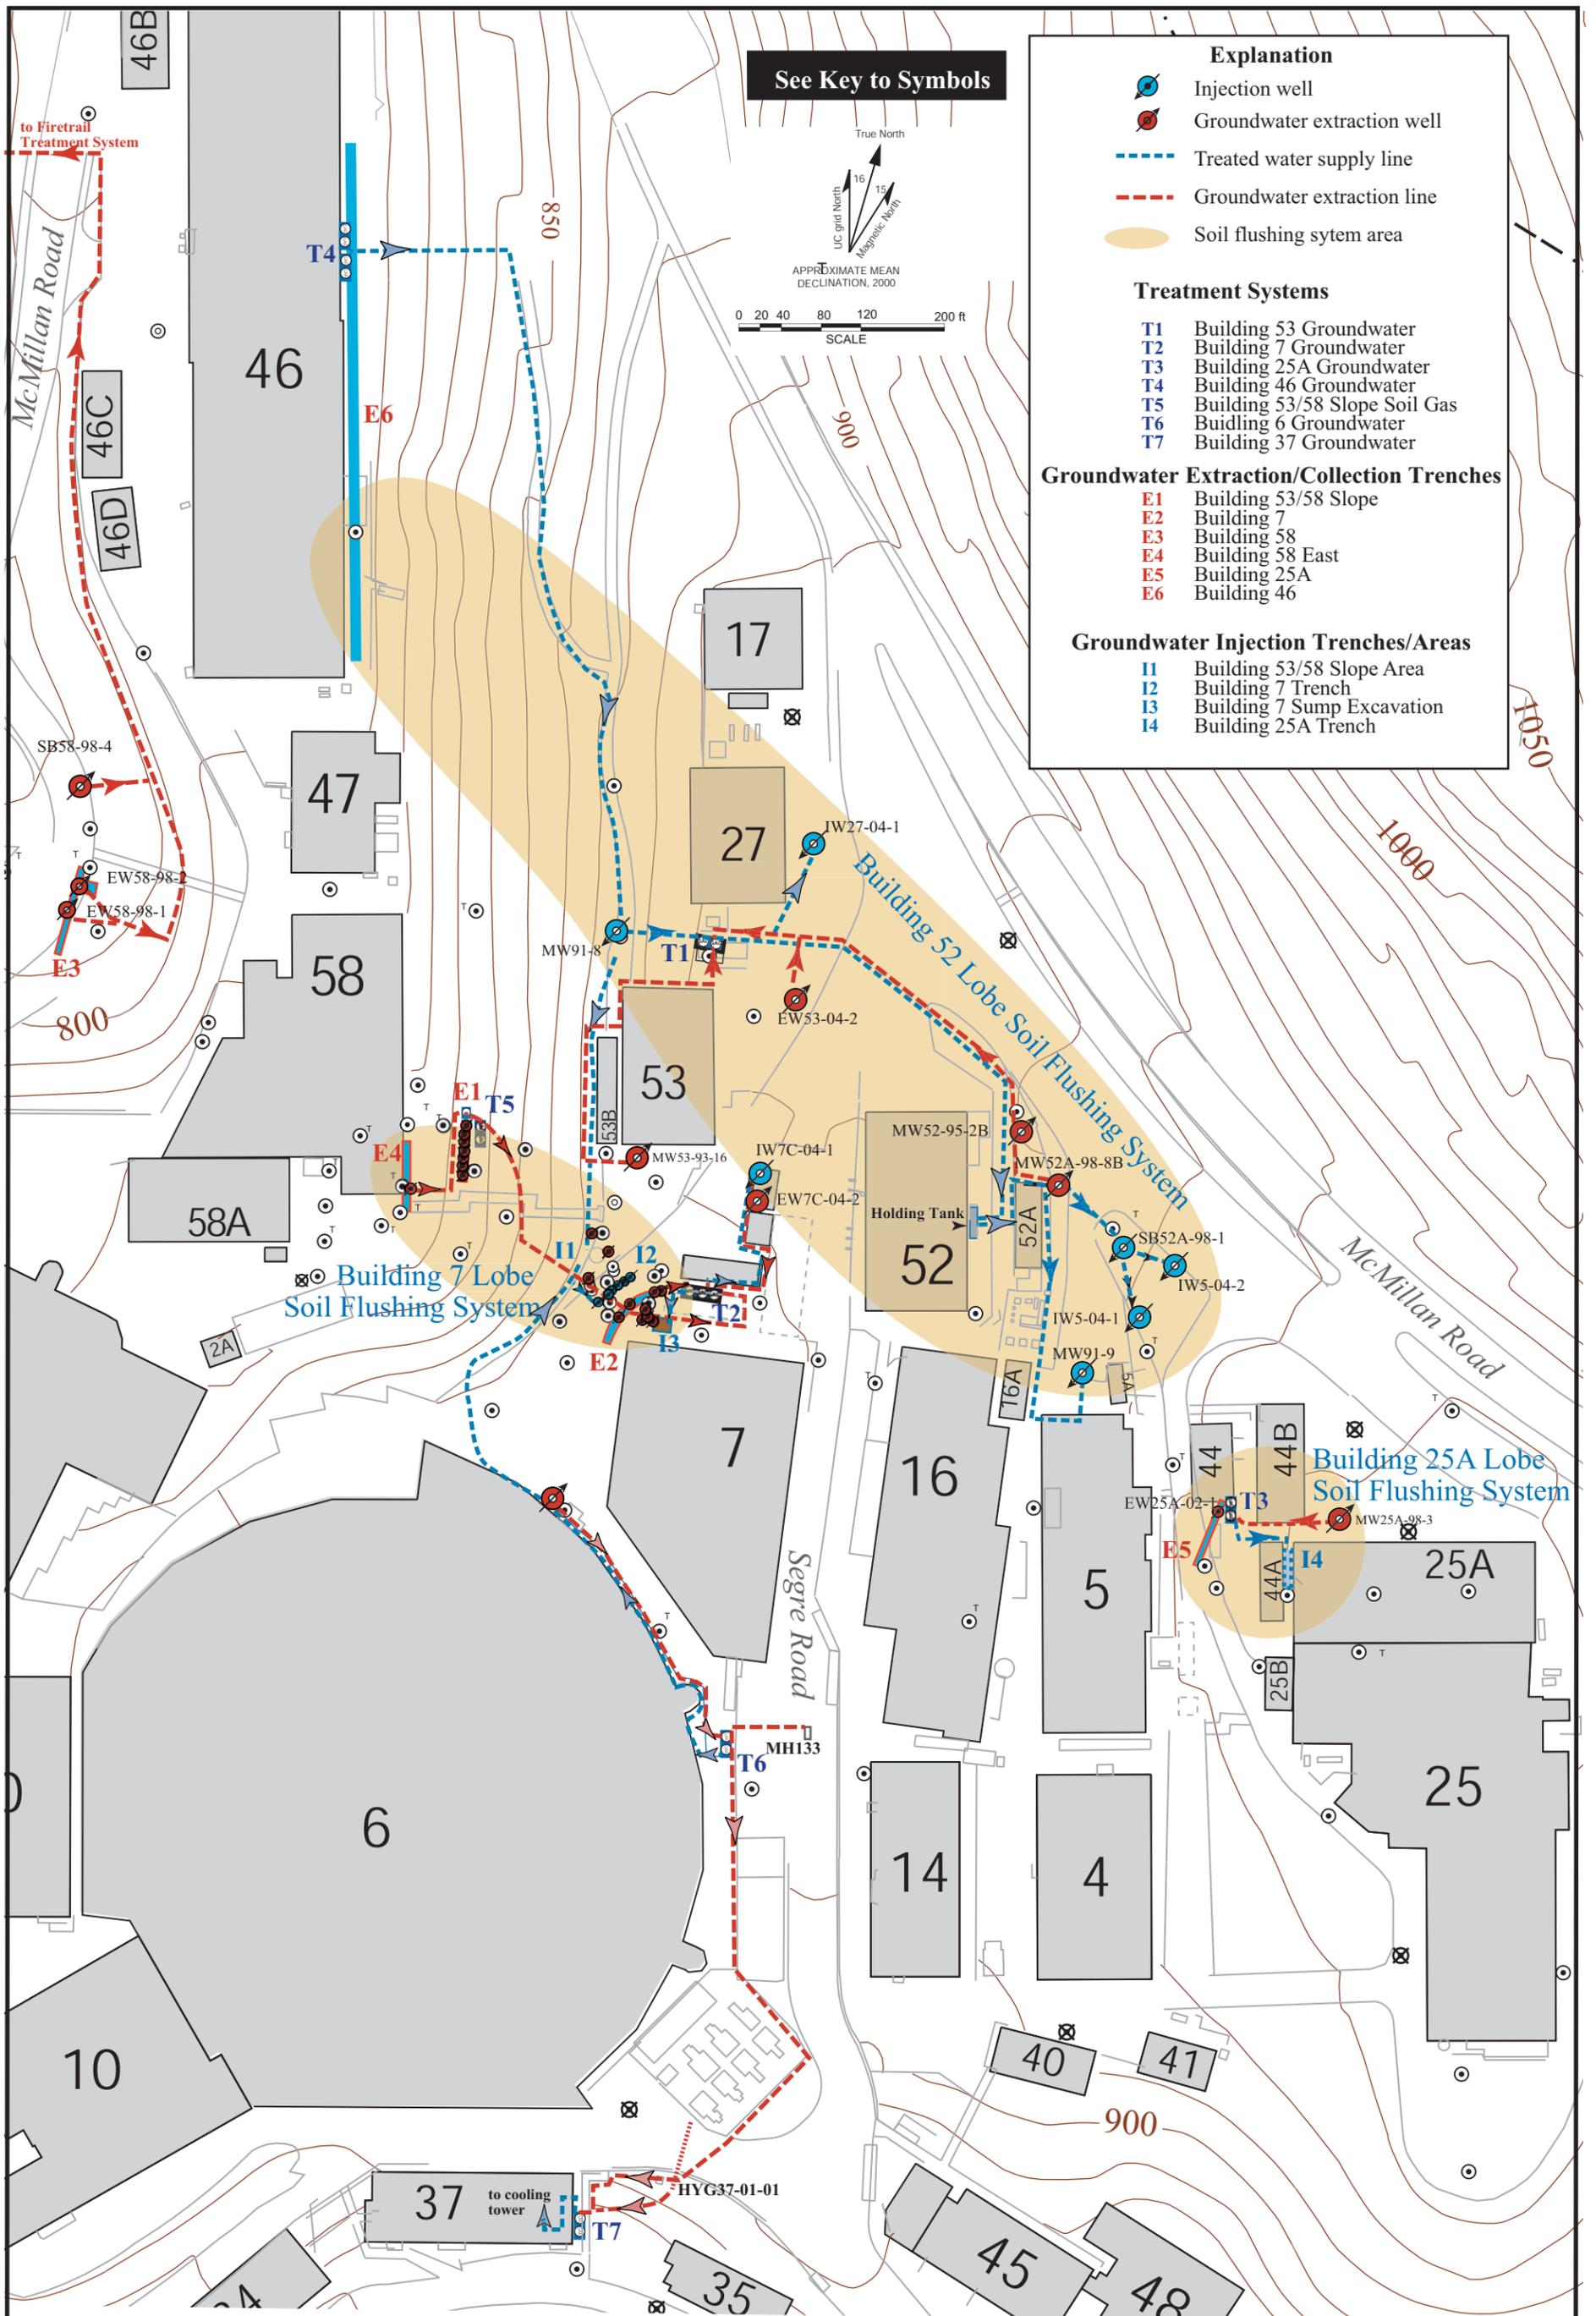



Figure 2.3. Soil Flushing and Groundwater Migration Control Systems, Old Town Groundwater Solvent Plume.

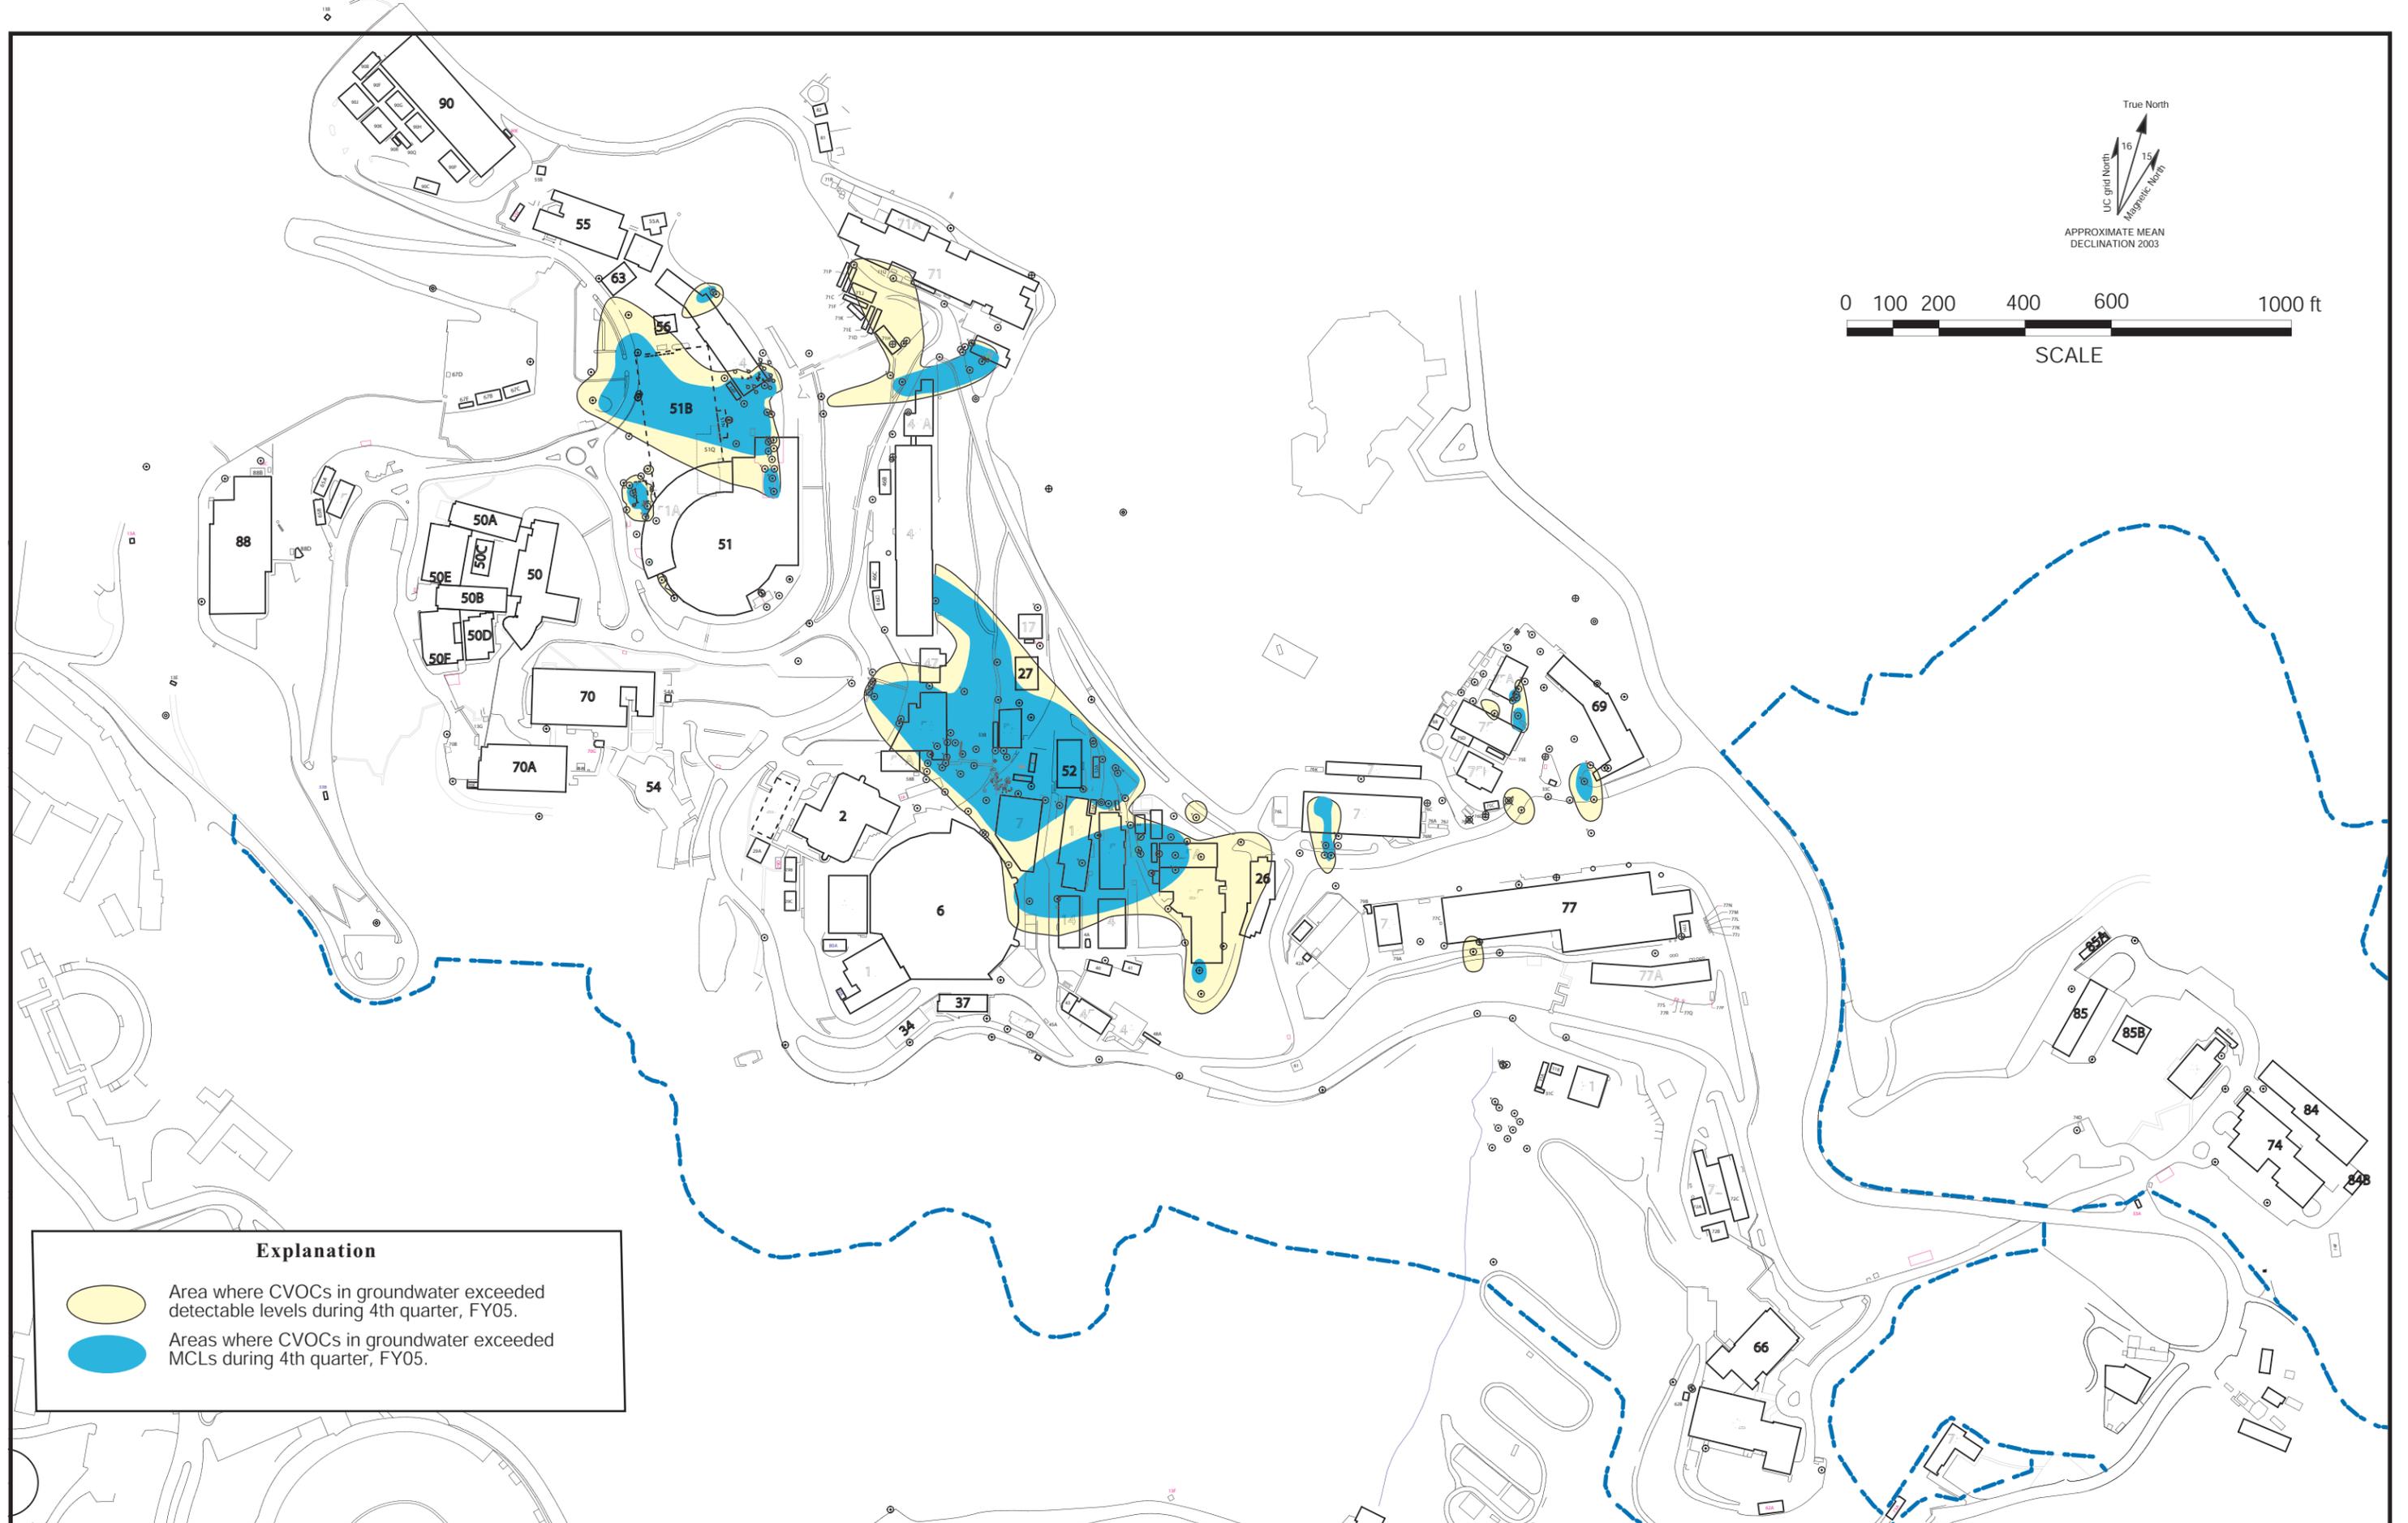

Explanation

- Area where CVOCs in groundwater exceeded detectable levels during 4th quarter, FY05.
- Areas where CVOCs in groundwater exceeded MCLs during 4th quarter, FY05.

Figure 4.1. Berkeley Lab Groundwater CVOC Plumes.

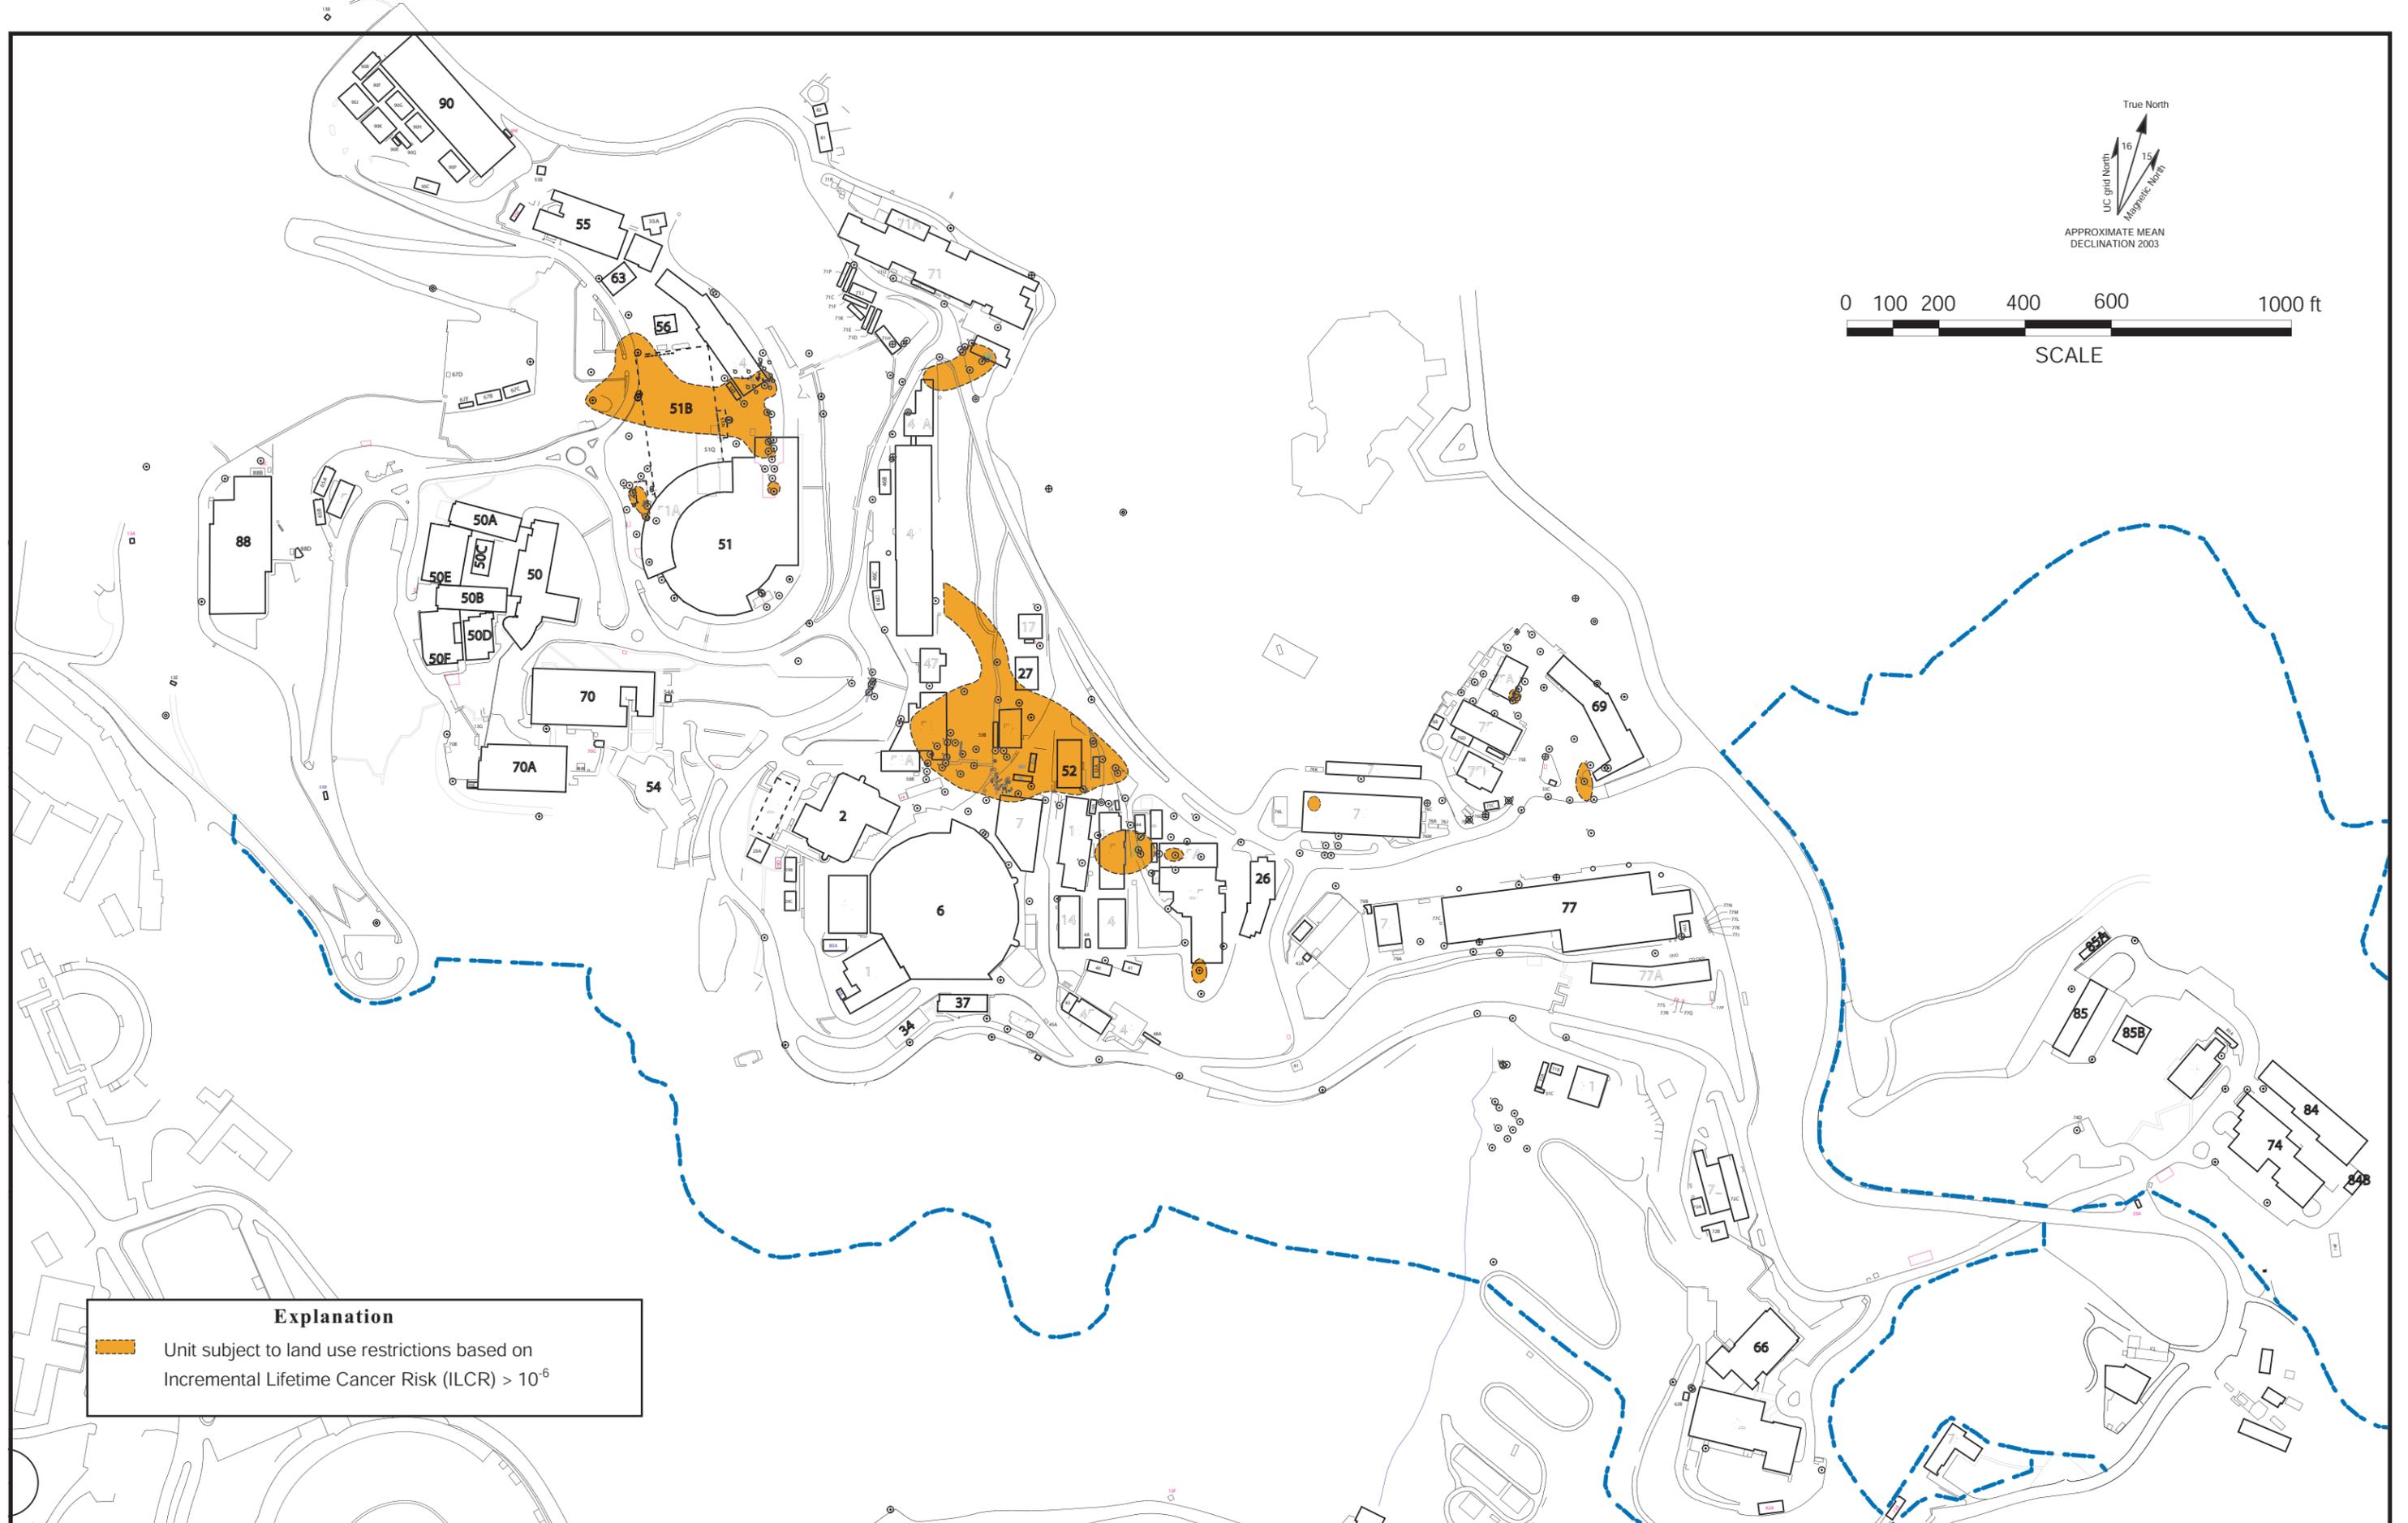

Explanation
 Unit subject to land use restrictions based on Incremental Lifetime Cancer Risk (ILCR) > 10⁻⁶

Figure 4.2. Extent of Land Not Suitable for Residential Use at Non-Radiological Units.



Figure 4.4. Locations of Areas of Underlain by Tritium-Contaminated Groundwater Not Released for Reuse by General Public.